



Dimensions 96 × 96 × 80 mm (1/4 DIN)

### Main features

- Operator interface with large LCD display and three configurable bar graph
- Scrolling diagnostics messages, configurable, in the selected language
- Easy, guided configuration, copy/ paste parameters even with power off
- Preventive maintenance with energy counters (kWh) and load switching
- 32 function block applications
- 8 math application blocks
- Timer, setpoint and algorithm programmer for controlling motorized valves
- Advanced tuning of control parameters
- Different password levels
- 2 universal inputs configurable for thermocouples, resistance thermometers, linear inputs
- 2 PID control loop
- 2 setpoint programmers (128 steps in 16 programs)
- Relay, logic, isolated analog outputs
- Up to two CT inputs for interrupted load diagnostics
- RS485 serial communication in Modbus RTU
- Removable faceplate for immediate replacement
- Sampling time 60 ms

### PROFILE

#### Operator interface

Large LCD display with customization of plastic front panel color and logo.

Graphic display of power, output current or valve position. Scrolling alphanumeric display of 25 messages (32 letters each), completely configurable and savable, in three languages.

Thanks to language selection and clear scrolling messages for diagnostics, alarms, and process state, the controller speaks the user's language.

#### Control

Double loop, two configurable universal inputs for thermocouples, resistance thermometers, linear inputs.

Second input can be configured as remote setpoint of single loop.

#### Easy Configuration

Guided configuration for manual-free programming, with a few essential parameters and on-line help messages.

Ability to clone configuration among controllers, even with power off and in the field, thanks to a mini portable configurator with Zapper battery.

Extended configuration, creation of work recipes, and firmware updates via PC and GF\_eXpress software, even without powering the controllers.

Thanks to the Smart Configurator function, you obtain the required parameter recipe by answering a few simple questions. Local configuration and operation with only four keys assigned to LEDs that serve as feedback for the pressed key and as guide to specify appropriate steps.

The initial parameters can always be reset, both from the keypad and from the GF\_eXpress Software tool.

#### Diagnostics, Preventive Maintenance, and Energy Monitor

Complete diagnostics for broken or incorrectly connected probe, total or partial load break, out of range variables, and control loop faults.

Thanks to the switching count and to the settable alarm thresholds, you can program preventive maintenance to replace worn actuators.

An internal energy counter with alarm for abnormal variations totalizes energy consumptions and costs for constant control.

#### Function block applications

32 AND, OR, Timer Function Blocks let you create customizable logic sequences for complete and flexible machine control.

The controller's hardware resources are exploited completely, without any need for external devices such as timers and small PLCs.

There are 8 math Function Blocks to process

analog variables and add/subtract/multiply/divide, calculate average, root, logarithms and control functions in cascade, and ratio check.

Options are available with 8 digital inputs/ outputs and 8 additional relay outputs to be managed via Function Blocks with state signals via dedicated LEDs on the LCD display.

#### Tuning

Advanced tuning algorithms ensure stable and accurate control even with critical or very rapid thermal systems, engaging automatically when necessary.

#### Timer

Three types of timers let you set delay times before activating the control, hold times on the setpoint value, and timed changes of programmed setpoints.

#### Setpoint Programmer

Models with 128 steps (each step consisting of a ramp and a hold), groupable in a maximum of 16 programs, are available for applications with setpoint profiles.

Enable inputs, event outputs, and messages to display can be assigned to each step. Double Programmer with synchronous and asynchronous base times for activating two setpoint profiles (even separate) assigned to the two loops.

On-board configuration and graphic configuration with GF\_eXpress.

### Valve Positioner

Models to control motorized valves, with or without feedback. The position is calculated for floating valves. For valves with potentiometer via auxiliary input you can control and display the position.

### Connectivity

Modbus RTU on RS485 2 wire connection.


### General characteristics

The controller is completely software configurable without accessing the internal electronics.

The universal main input accepts thermocouple sensors, resistance thermometers, and linears.

The controller can be replaced at any time simply by removing the faceplate, without any additional procedures.


## DISPLAY AND KEYS

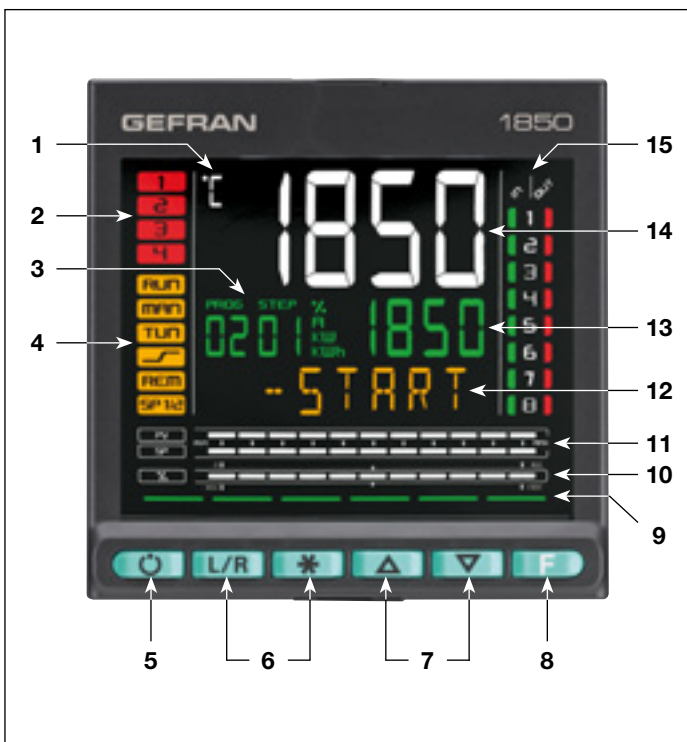

- Key function configurable with parameters but2 and but3. The keys are active only when the display shows the process variable. (HOME).
- Up/down keys: raise/lower the value of the parameter displayed on the SV or PV display.
- F key: lets you navigate among controller menus and parameters. Confirms the parameter value and selects the next parameter.
- Key pressed signals.
- Displays percentage of power or current, configurable with parameter bArG.
- Display of percentage of process variable and of setpoint.
- F display: parameters, diagnostics and alarm messages. Configurable with parameter dS.F (default = setpoint).
- SV display: parameter values. Configurable with parameter dS.SP (default = setpoint).
- PV display: process variable.
- Display of inputs/outputs state (only with 8 INS/OUTS and/or 8 relays option).

- Unit of measurement or number of program running or number of loop displayed.
- State of outputs OUT1, OU2, OUT3, OUT4.
- Displays program number, step number, unit of measurement (% , A, kW, kWh).
- Controller function states:
  - RUN = functioning (flashing = normal functioning, steady on = program running);
  - \_/- = setpoint ramp active;
  - TUN = PID parameters tuning active;
  - MAN = manual/automatic (off = automatic control, on = manual control);
  - REM = remote setpoint enabled;
  - SP1/2 = setpoint active (off = setpoint 1, on = setpoint 2).
- Work mode key (manual/automatic) in standard mode. A function can be assigned via parameter but1. The key is active only when the display shows the process variable. (HOME).

# DIMENSIONS AND DRILLING TEMPLATE

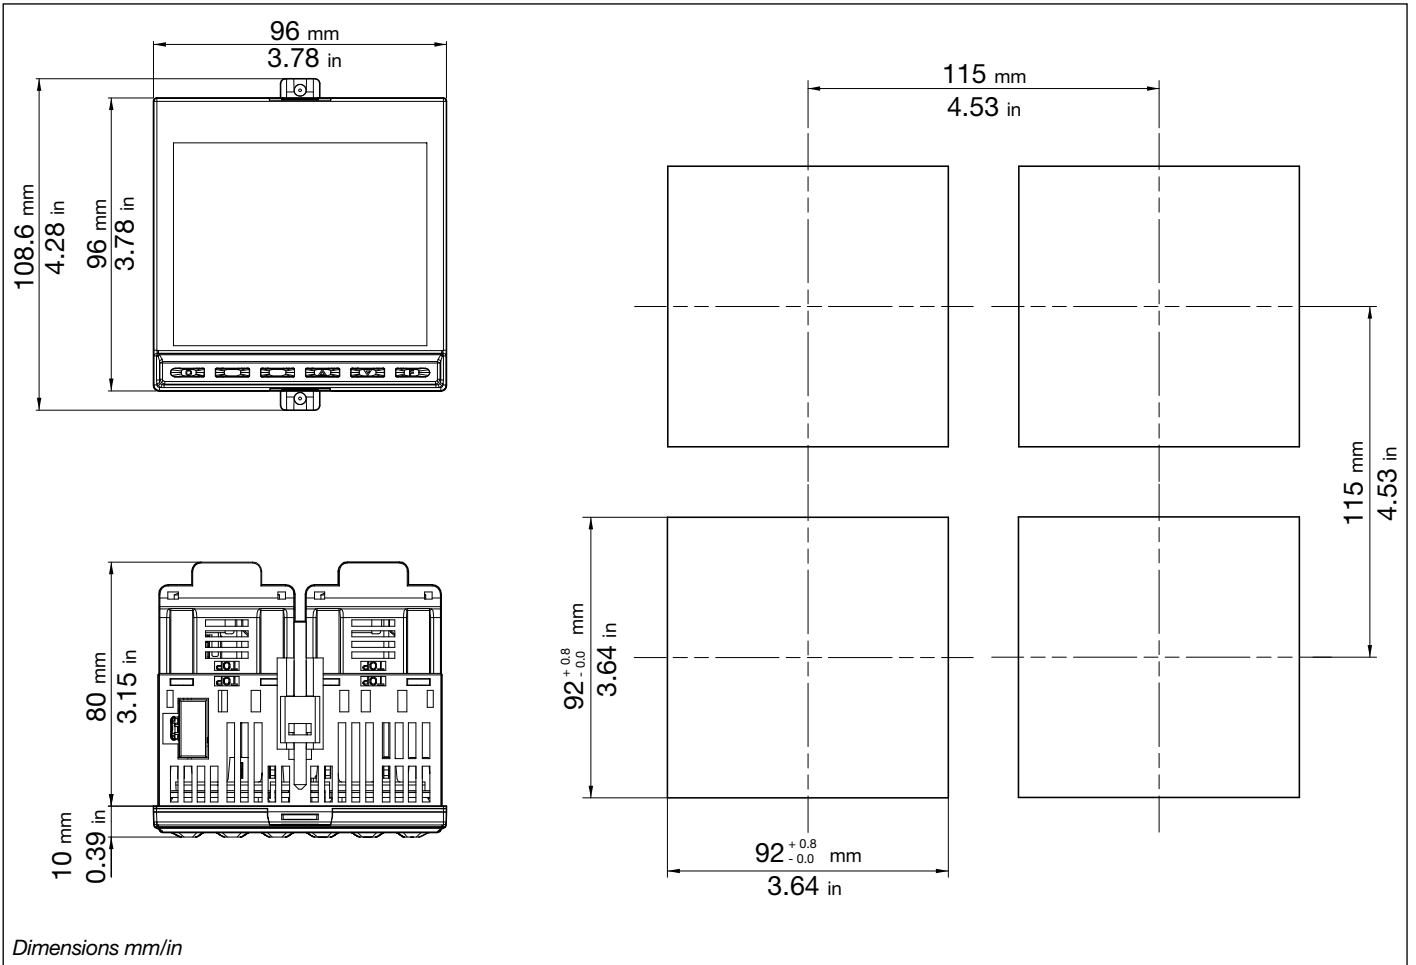

**TECHNICAL DATA**
**OPERATOR INTERFACE**

<b>DISPLAY</b>	Type	LCD black background
	Screen area (L x H)	83 x 68 mm
	Lighting	Backlit with LEDs, life > 40,000 hours @ 25°C (with brightness level backl = 0.8)
	PV display	Number of digits: 4 to 7 segments, with decimal point Digit height: 23 mm Color: white
	SV display	Number of digits: 4 to 7 segments, with decimal point Digit height: 11 mm Color: green
	F display	Number of digits: 7 to 14 segments, with decimal point Digit height: 9 mm Color: amber
	Unit of measurement	Selectable, °C, °F or custom <sup>1</sup> Color: same as PV display
	Controller state signals	Number: 6 (RUN, MAN, _/-, REM, SP1/2) Color: amber
	Output state signals	Number: 4 (1, 2, 3, 4) Color: red
	Bargraph indicator, configurable	Type: graphic bargraph, 11 segments Power indication: 0...100% or -100...100% Current indication: 0...100% f.s. Valve position indication: 0...100%
	Bargraph indicator	Type: double bar, 11 segments Indication of process variable and setpoint: 0...100% f.s.
	Inputs/outputs state signal (only with option)	Number: 8 inputs, 8 outputs Color: green for inputs, red for outputs Control via FB outputs
<b>KEYPAD</b>		Keys number: 6, silicone (Man/Auto, L/R, *, INC, DEC, F) Type: mechanical

**INPUTS**

<b>MAIN INPUT</b>	Sensor type	TC, RTD (PT100, JPT100), IR ES1B, DC linear sensor
	Accuracy	<b>TC input</b> Calibration accuracy: < ± (0,25% of reading in °C +0,1°C) Linearization accuracy: 0,1% of reading Cold junction accuracy: < ± 1°C a 25°C ambient temperature Cold junction compensation: > 30:1 rejection to the change of the ambient temperature <b>RTD input</b> Calibration accuracy: < ± (0,15% of reading in °C +0,4°C) Temperature drift: < ± (0,005% of reading in °C +0,015°C)/°C from 25°C ambient temperature Linearization accuracy: 0,1% of reading <b>Linear input:</b> Calibration accuracy: < 0,1% F.S. Temperature drift: < ± 0,005% F.S. /°C from 25°C ambient temperature
	Sampling time	60 ms / 120 ms, selectable
	Digital filter	0,0...20,0 s
	Temperature unit of measurement	Degrees C / F, selectable from keypad
	Signal interval	Type: linear Scale: -1999...9999, settable decimal point
	TC (thermocouple) input	Thermocouple: J, K, R, S, T, C, D Linearization: ITS90 or custom
	RTD (resistance thermometer) input	Resistance thermometer: PT100, JPT100 Input impedance (Ri): ≥ 30 kΩ Linearization: DIN 43760 or custom Max. line resistance: 20 Ω
DC linear input	0...60 mV                   input impedance (Ri): > 70 kΩ 0...1 V                   input impedance (Ri): > 15 kΩ 0...5 V / 0...10 V       input impedance (Ri): > 30 kΩ 0/4...20 mA           input impedance (Ri): 50 Ω Linearization: linear or custom	

<b>AUXILIARY INPUT</b>	Sensor type	TC, RTD (PT100, JPT100), IR ES1B, DC linear sensor
	Accuracy	<b>TC input</b> Calibration accuracy: <math>\pm 0,25\%</math> of reading in $^{\circ}\text{C} +0,1^{\circ}\text{C}</math>Linearization accuracy: 0,1% of readingCold junction accuracy: <math>\pm 1^{\circ}\text{C}</math> a 25^{\circ}\text{C}</math> ambient temperatureCold junction compensation: > 30:1 rejection to the change of the ambient temperatureRTD inputCalibration accuracy: <math>\pm 0,15\%</math> of reading in ^{\circ}\text{C} +0,4^{\circ}\text{C}</math>Temperature drift: <math>\pm 0,005\%</math> of reading in ^{\circ}\text{C} +0,015^{\circ}\text{C}</math> /^{\circ}\text{C}</math> from 25^{\circ}\text{C}</math> ambient temperatureLinearization accuracy: 0,1% of readingLinear input:Calibration accuracy: <math>< 0,1\%</math> F.S.Temperature drift: <math>\pm 0,005\%</math> F.S. /^{\circ}\text{C}</math> from 25^{\circ}\text{C}</math> ambient temperature$
	Sampling time	60 ms / 120 ms, selectable
	Digital filter	0,0...20,0 s
	Temperature unit of measurement	Degrees C / F, selectable from keypad
	Signal interval	Type: linear Scale: -1999...9999, settable decimal point
	TC (thermocouple) input	Thermocouple: J, K, R, S, T, C, D Linearization: ITS90 or custom
	RTD (resistance thermometer) input	Resistance thermometer: PT100, JPT100 Input impedance (Ri): $\geq 10\text{ M}\Omega</math>Linearization: DIN 43760 or customMax. line resistance: 20\ \Omega</math>$
	DC linear input	0...60 mV                    input impedance (Ri): $> 10\text{ M}\Omega</math>0...1 V                     input impedance (Ri): > 300\text{ k}\Omega</math>0...5 V / 0...10 V        input impedance (Ri): > 300\text{ k}\Omega</math>0/4...20 mA                input impedance (Ri): 50\ \Omega</math>Linearization: linear or custom$
Isolation	Functional isolation 250 V	
<b>CT (ammeter) input</b>	Type	Isolated via external transformer
		Number: 2 max Max. capacity: x / 50 mA AC Line frequency: 50/60 Hz Input impedance (Ri): $10\ \Omega</math>$
	Accuracy	$\pm 2\%$ f.s. $\pm 1$ digit @ $25^{\circ}\text{C}</math>$
<b>DIGITAL INPUTS</b>	Numero	5 max
	Type	voltage-free contact, or NPN 24 V - 4,5 mA, o PNP 12/24 V - max 3,6 mA <i>For detail see electrical connections</i>
	Isolation	250 V

<b>OUTPUTS</b>		
	Relay (R)	Number: 4 max Type of relay contact: NO Max. current: 5A (2A at ambient temperature up to 45 ° C for certification UL), 250VAC / 30 VDC, $\cos\phi = 1$ Minimum load: 5 V, 10 mA Life cycle: > 100.000 operations Double isolation
	Logic (D)	Number: 2 max Type: for solid-state relays Voltage: 24 V $\pm 10\%$ (min 10 V @20 mA) Isolated from main input
	Isolated logic (M)	Number: 2 max Type: MOS optoisolated for PLC inputs and AC/DC load Voltage: 30 V AC/DC max Current: 100 mA max Resistance ON: 0,8 $\Omega$ max Isolation: 1500 V
	Triac ( long life relè) (T)	Number: 1 max Load: resistive Voltage: 75...240 VAC Current max: 1 A Isolation 3 kV snubber circuit integrated zero crossing switching
	Continuous (C)	Number: 1 max Current: 4...20mA $R_{out} < 500 \Omega$ Resolution: 12 bit Isolated from main input
	Analog retransmission (A1) (A2)	Number: 2 max 0...10 V, max 20 mA, $R_{out} > 500 \Omega$ 0...20 mA, 4...20 mA, $R_{out} < 500 \Omega$ Resolution: 12 bit Isolated from main input
<b>ALARMS</b>	Number of alarm functions	4 max, assignable to an output
	Possible configurations	Maximum, minimum, symmetric, absolute/relative, exclusion at firing, memory, reset from keypad and/or contact, LBA, HB, HBB Hold Back Band if enabled with Programmer function, alarm after power variation at full power
<b>POWER SUPPLY</b>	For sensor VT, VT2	Voltage: 24 VDC $\pm 10\%$ Current max: 30 mA VT option of Out3
	For potentiometer VP	Voltage: 1 VDC $\pm 1\%$ Current max: 30 mA
<b>INPUTS / OUTPUTS</b>		
	Digital Inputs/Outputs	Number: 8, in two groups (5 + 3 with separate power supply) Input: PNP 24 VDC, 5 mA Output: PNP with 24 VDC external power supply, $\pm 25\%$ , max 100 mA, short circuit protection with PTC Isolation: 250 V
	Relay	Number: 8, in two groups (5 + 3 relays with common contact) Type of relay contact: NO Max. current: 5A (at ambient temperature up to 45 ° C for certification UL), 250VAC / 30 VDC, $\cos\phi = 1$ Max. current for each common: 5 A Life cycle: > 100.000 operations Double isolation
<b>CONTROL FUNCTIONS</b>		
<b>CONTROL</b>	Type	Single/Double loop
	Control	PID, ON/OFF, single action heat or cool, double action heat/cool
	Control output	Continuous or ON/OFF Cycle time: constant or optimized (BF)
	Control output for motorized valves	OPEN/CLOSE for floating motorized valve or with feedback with position control by potentiometer on Relay, Solid-state, Triac outputs.

<b>SETPOINT PROGRAMMER</b> (Double programmer if double loop)	Number of programs	Max 16 (if double loop 8 + 8) Start / Stop / Reset / Skip via digital inputs and/or outputs from logic operations Output state: Run /Hold / Ready / End
	Number of steps	Max 128, each with own setpoint, ramp time and hold time Times settable in HH:MM or MM:SS Max 4 consents, configurable for ramp and for hold Max 4 events, configurable in ramp and in hold
<b>MULTIPLE SETPOINTS</b>	Number of setpoints	Max 4, selectable from digital input Each setpoint change is subject to set ramp, different for up and down ramp
<b>LOGIC <sup>1</sup> OPERATIONS</b>	Digital function blocks	Max 32, with 4 input variables per block. The result can act on the state of the controller, of the programmer on alarms and outputs. Each function has an AND, OR with TIMER block
<b>OPERATIONS MATHEMATICAL <sup>1</sup></b>	Analog function blocks	Max 8, with 2 input variables per block, with operators such as +, -, ×, ÷, average, square root, ... The result may act on analog variables in input to PID loops (controlled variable, setpoint) or analog outputs .
<b>TIMER FUNCTION</b>	Modes	START / STOP (2 timer if double loop) STABILIZATION (timer is on when PV enters a band set around setpoint; at end of count you can activate an output, shut down SW or change SP1/SP2) FIRING (timed activation of control after power on)
<b>ENERGY COUNTER</b>		Calculation done on nominal line voltage and nominal load power or on rms current measured on load via CT
<b>DIAGNOSTIC</b>		Short circuit or open circuit (LBA alarm) Interrupted or partially interrupted load (HB alarm) Short circuit of control output (SSR alarm)
<b>RETENTIVE MEMORY</b>	Type	FRAM
	Writes	Number max: > 10 <sup>10</sup> cycles Retention: > 10 years
<b>GENERAL DATA</b>		
<b>POWER SUPPLY</b>	Operating voltage	100...240 VAC/VDC ±10%, 50/60 Hz (20...27 VAC/VDC ±10%, 50/60 Hz)
	Power dissipation	12 W max
	Protections	Overvoltage 300 V / 35 V
	Connection	Screw terminals and crimp connector, max. wire section 1 mm <sup>2</sup>
<b>CONNECTIONS</b>	Serial configuration port	Connector: microUSB
	RS485 (option)	Baudrate: 1200, 2400, 4800, 9600, 19.200, 38.400, 57.600, 115.200 bit/s Protocol: Modbus RTU Insulation compared to main entrance Screw terminals and crimp connector, max. wire section 2.5 mm <sup>2</sup>
	Inputs and outputs	Screw terminals and crimp connector, max. wire section 2.5 mm <sup>2</sup>
<b>AMBIENT CONDITIONS</b>	Use	Internal
	Altitude	2000 m max
	Operating temperature	-10 ... +55 °C (as per IEC 68-2-14)
	Storage temperature	-20 ... +70 °C (as per IEC 68-2-14)
	Relative humidity	20...85% RH non condensante (as per IEC 68-2-3)
<b>PROTECTION LEVEL</b>		IP 65 on front panel (as per IEC 68-2-3)
<b>ASSEMBLY</b>	Positioning	On panel, removable faceplate
	Installation regulations	Installation category: II Pollution degree: 2 Isolation: double
<b>DIMENSIONS</b>		96 X 96 mm (1/4 DIN) Depth: 80 mm
<b>WEIGHT</b>		0,24 kg
<b>CE STANDARDS</b>	EMC (electromagnetic compatibility)	Conforms to Directive 2014/30/EU norme EN 61326-1 Emissions in industrial environment classe A
	LVD safety	Conforms to Directive 2014/35/EU norme EN 61010-1


1) Programming is done with the GF\_eXpress configuration program.

**ACCESSORIES**



<b>Code</b>	<b>Description</b>
<b>F060800</b>	Cable for programming with PC, USB-TTL 3 V with USB – microUSB connectors, length 1.8 m
<b>F043958</b>	“GF_eXpress” software CD
<b>F060909</b>	Configuration kit for new instruments
<b>51970</b>	Rubber gasket 96×96 front box
<b>51069</b>	Rubber gasket 99×96 box-panel
<b>49030</b>	Fastening box to panel
<b>51328</b>	Protection of contacts at box bottom
<b>51738</b>	36 contacts at box bottom
<b>330200</b>	Current transformer (CT) 50/0.05 A
<b>330201</b>	Current transformer (CT) 25/0.05 A



# CONNECTION DIAGRAM






**OUT 4**



**Option  
Modbus RTU (M) = M0  
Communication**

B (Data +)  
A (Data -)

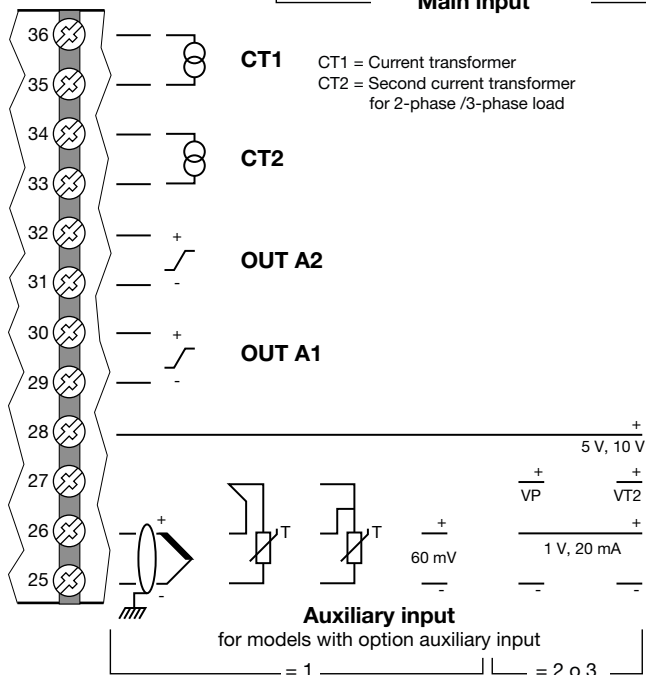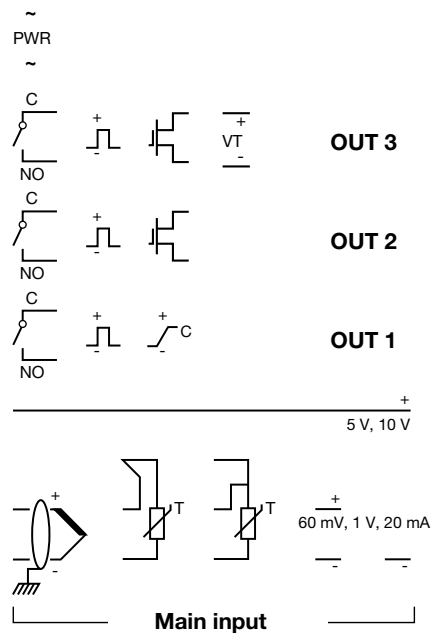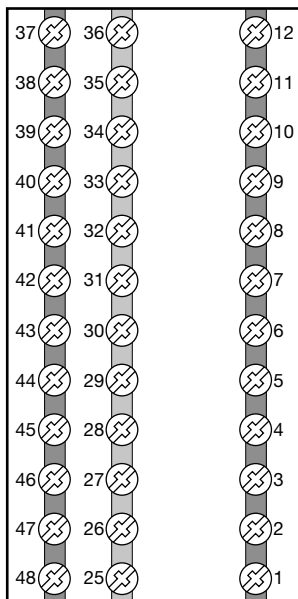

## LEGEND

- ~ PWR Power supply
- + Linear input in voltage / current
- Input for current transformer
- + AUX Auxiliary input

- Isolated digital inputs
- Thermocouple input
- Input PT100 JPT100 2 / 3 wires


- Relay output
- Long-life solid state relay output
- Logic output
- Isolated logic output
- Isolated analog output

- B (Data +) RS485 serial line
- A (Data -)
- + VT Supply transmitter
- + VP Supply potentiometer



**ATTENTION:** For correct installation, read the warnings in the instruction manual.

**CONNECTION DIAGRAM**

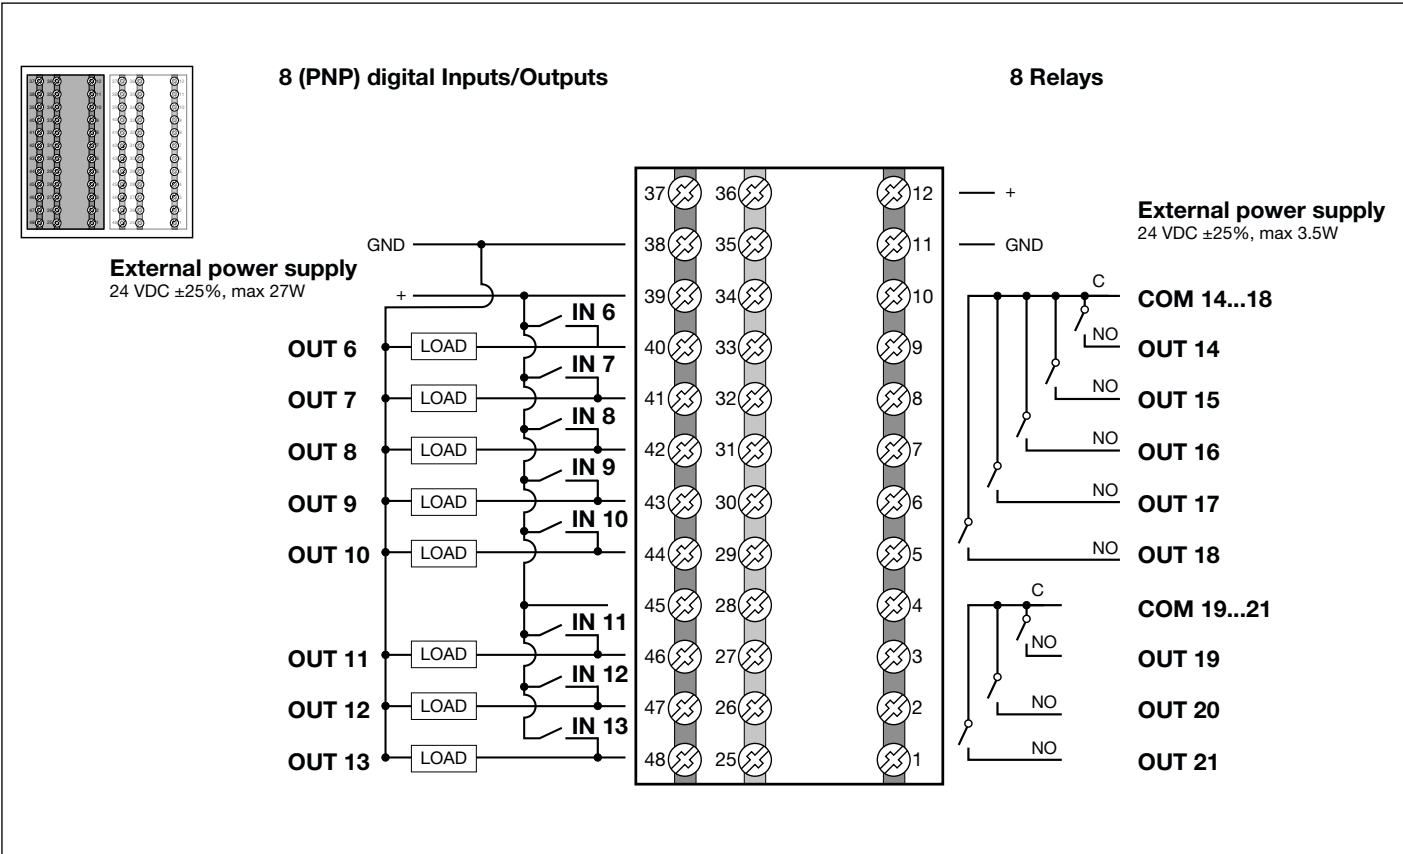

**⚠ ATTENTION:** For correct installation, read the warnings in the instruction manual.

## ORDER METHODS

Ordering code: 1850 X-X-XXX-0-X-XX-X-XX-X-XX

Model (A)	
Controller	
Programmer	P
Valve <sup>5</sup>	V
Programmer+valve <sup>5</sup>	PV

Output 1 (B)	
Relay	R
Logic	D
Analog	C

Output 2 (C) - Output 3 (D)	
Relay - Relay	R R
Logic - Logic	D D
Isolated logic - Isolated logic	MM
Relay - VT 24 V	R V
Logic - VT 24 V	D V
Isolated logic - VT 24 V	M V

Output 4 (E)	
Absent	0
Relay	R
Long Life relay	T

Retransmission (G)	
Absent	0
Analogue A1	1
Analogue A1 + A2	2

Fonction (P)	
00	Absent
FB	Logical + mathematical operations

Supply (O)	
0	20...27 VAC / VDC
1	100...240 VAC / VDC

I/O optional (N) <sup>4</sup>	
00	Absent
10	8 IN/OUT
01	8 relay
11	8 IN/OUT + 8 relay

Communication (M)	
00	Absent
M0	RS485 Modbus RTU

Digital inputs (L)	
0	Absent <sup>3</sup>
5	5 DI

Auxiliary input (I)	
0	Absent
1	Input Aux <sup>2</sup>
2	Input Aux + VP 1 V <sup>1</sup>
3	Input Aux + VT2 24 V <sup>1</sup>

CT Input (H)	
0	Absent
2	CT1 + CT2

### Note

- 1) Auxiliary input type 1 V / 5 V / 10 V / 20 mA
- 2) Auxiliary input type TC / RTD / 60 mV
- 3) Only for option H-I = 0
- 4) The N options require P = FB option
- 5) V and PV models required (CD) =RR

Check before each request a list of codes available on the following pages

## ORDER METHODS

### Power supply 100...240 VAC/VDC

Code F	Model	Valves	Programmer	Inputs				Outputs						I/O AUX		Communica-tions		Logic + mathematical functions	Total Number of Outputs		
				Digital	CT	AUX ( TC/RTD/60mV)	AUX (1V/5V/10V/20mA) +VP	AUX (1V/5V/10V/20mA) +VT	Relay	Triac	Logic SSR	Logic isolated	Analog I	Analog V/I	Power supply sensor	Digital Inputs / Outputs	Outputs relay			RS485 modbus RTU	
F065321	1850-D-RVR-0-0-00-5-00-00-1-00			5				2	1					•							3 outputs
F065322	1850-R-RVR-0-0-00-5-00-00-1-00			5				3						•							
F067164	1850-R-DDR-0-0-01-5-00-00-1-FB			5	•			2	2											•	4 outputs
F065331	1850-R-DDR-0-0-03-5-00-00-1-FB			5			•	2	2											•	
F067165	1850-R-DDR-0-0-01-5-M0-00-1-FB			5	•			2	2										•	•	
F065332	1850-R-DDR-0-0-03-5-M0-00-1-FB			5			•	2	2										•	•	
F067167	1850-C-RRR-0-0-01-5-00-00-1-FB			5	•			3				1								•	
F067168	1850-C-RRR-0-0-03-5-00-00-1-FB			5			•	3				1								•	
F065334	1850-D-RRR-0-0-20-0-M0-00-1-00				2			3	1											•	
F065350	1850V-D-RRR-0-0-02-5-M0-00-1-00	•		5		•		3	1											•	
F065355	1850P-D-RRR-0-0-00-5-00-00-1-00		•	5				3	1												
F067169	1850P-D-RRR-0-0-01-5-00-00-1-FB		•	5	•			3	1											•	
F065361	1850P-D-RRR-0-0-03-5-00-00-1-FB		•	5			•	3	1											•	
F065370	1850PV-D-RRR-0-0-02-5-00-00-1-FB	•	•	5		•		3	1											•	
F065330	1850-R-RRR-0-0-02-5-00-00-1-00			5		•		4													
F065348	1850V-R-RRR-0-0-02-5-00-00-1-00	•		5		•		4													
F067172	1850V-R-RRR-0-0-01-5-00-00-1-00	•		5	•			4													
F065349	1850V-R-RRR-0-0-03-5-00-00-1-00	•		5			•	4													
F067173	1850-R-DDR-0-2-01-5-00-10-1-FB			5	•			2	2			2		•						•	4 (+8) outputs
F067174	1850-R-DDR-0-2-03-5-00-10-1-FB			5			•	2	2			2		•						•	
F067175	1850-R-DDR-0-2-01-5-M0-01-1-FB			5	•			2	2			2		•	•					•	
F067176	1850-R-DDR-0-2-03-5-M0-01-1-FB			5			•	2	2			2		•	•					•	
F065368	1850P-R-RRR-0-0-00-5-00-10-1-FB		•	5				4						•						•	
F067179	1850-R-RVR-0-2-01-5-M0-00-1-00			5	•			3				2	•							•	5 outputs
F065340	1850-R-RVR-0-2-03-5-M0-00-1-00			5			•	3				2	•							•	
F065351	1850V-D-RRR-0-1-02-5-00-00-1-00	•		5		•		3	1			1									
F065352	1850V-D-RRR-0-1-02-5-M0-00-1-00	•		5		•		3	1			1								•	
F067180	1850V-D-RRR-0-1-01-5-M0-00-1-00	•		5	•			3	1			1								•	
F065353	1850V-D-RRR-0-1-03-5-M0-00-1-00	•		5			•	3	1			1								•	
F065354	1850V-R-RR0-0-2-00-0-00-00-1-00	•						3				2									
F065364	1850P-D-RRR-0-1-02-5-M0-00-1-00		•	5		•		3	1			1								•	
F067181	1850-R-RRR-0-1-01-5-00-00-1-00			5	•			4				1									
F065338	1850-R-RRR-0-1-03-5-00-00-1-00			5			•	4				1									
F067182	1850-R-RRR-0-1-01-5-M0-00-1-00			5	•			4				1								•	
F065339	1850-R-RRR-0-1-03-5-M0-00-1-00			5			•	4				1								•	
F067183	1850P-R-RRR-0-1-01-5-M0-00-1-00		•	5	•			4				1								•	
F065365	1850P-R-RRR-0-1-03-5-M0-00-1-00		•	5		•		4				1								•	

**Note:** Please contact GEFRA for information on available codes.



**Power supply 20...27 VAC/VDC**

Code F	Model	Valves	Programmer	Inputs				Outputs						I/O AUX	Communica-tions		Logic + mathematical functions	Total Number of Outputs	
				Digital	CT	AUX ( TC/RTD/60mV)	AUX (1V/5V/10V/20mA) +VP	AUX (1V/5V/10V/20mA) +VT	Relay	Triac	Logic SSR	Logic isolated	Analog I		Analog V/I	Power supply sensor			Digital Inputs / Outputs
F065269	1850-D-RVR-0-0-00-5-00-00-0-00			5				2	1					•					3 outputs
F065270	1850-R-RVR-0-0-00-5-00-00-0-00			5				3						•					3 outputs
F067188	1850-R-DDR-0-0-01-5-00-00-0-FB			5	•			2	2									•	4 outputs
F065279	1850-R-DDR-0-0-03-5-00-00-0-FB			5			•	2	2									•	
F067189	1850-R-DDR-0-0-01-5-M0-00-0-FB			5	•			2	2								•	•	
F065280	1850-R-DDR-0-0-03-5-M0-00-0-FB			5			•	2	2								•	•	
F067191	1850-C-RRR-0-0-01-5-00-00-0-FB		•	5	•			3				1						•	
F067192	1850-C-RRR-0-0-03-5-00-00-0-FB		•	5			•	3				1						•	
F065282	1850-D-RRR-0-0-20-0-M0-00-0-00			2				3	1								•		
F065298	1850V-D-RRR-0-0-02-5-M0-00-0-00	•		5		•		3	1								•		
F065303	1850P-D-RRR-0-0-00-5-00-00-0-00		•	5				3	1										
F067193	1850P-D-RRR-0-0-01-5-00-00-0-FB		•	5	•			3	1									•	
F065309	1850P-D-RRR-0-0-03-5-00-00-0-FB		•	5			•	3	1									•	
F065318	1850PV-D-RRR-0-0-02-5-00-00-0-FB	•	•	5		•		3	1									•	
F065278	1850-R-RRR-0-0-02-5-00-00-0-00			5		•		4											
F065296	1850V-R-RRR-0-0-02-5-00-00-0-00	•		5		•		4											
F067196	1850V-R-RRR-0-0-01-5-00-00-0-00	•		5	•			4											
F065297	1850V-R-RRR-0-0-03-5-00-00-0-00	•		5			•	4											
F067197	1850-R-DDR-0-2-01-5-00-10-0-FB			5	•			2	2			2		•				•	4 (+8) outputs
F067198	1850-R-DDR-0-2-03-5-00-10-0-FB			5			•	2	2			2		•				•	
F067199	1850-R-DDR-0-2-01-5-M0-01-0-FB			5	•			2	2			2		•	•			•	
F067200	1850-R-DDR-0-2-03-5-M0-01-0-FB			5			•	2	2			2		•	•			•	
F065316	1850P-R-RRR-0-0-00-5-00-10-0-FB		•	5				4						•				•	
F067203	1850-R-RVR-0-2-01-5-M0-00-0-00			5	•			3				2	•					•	
F065288	1850-R-RVR-0-2-03-5-M0-00-0-00			5			•	3				2	•					•	
F065299	1850V-D-RRR-0-1-02-5-00-00-0-00	•		5		•		3	1			1							
F065300	1850V-D-RRR-0-1-02-5-M0-00-0-00	•		5		•		3	1			1						•	
F067204	1850V-D-RRR-0-1-01-5-M0-00-0-00	•		5	•			3	1			1						•	
F065301	1850V-D-RRR-0-1-03-5-M0-00-0-00	•		5			•	3	1			1						•	
F065302	1850V-R-RRR-0-2-00-0-00-00-0-00	•						3				2							
F065312	1850P-D-RRR-0-1-02-5-M0-00-0-00		•	5		•		3	1			1						•	
F067205	1850-R-RRR-0-1-01-5-00-00-0-00			5	•			4				1							
F065286	1850-R-RRR-0-1-03-5-00-00-0-00			5			•	4				1							
F067206	1850-R-RRR-0-1-01-5-M0-00-0-00			5	•			4				1						•	
F065287	1850-R-RRR-0-1-03-5-M0-00-0-00			5			•	4				1						•	
F067207	1850P-R-RRR-0-1-01-5-M0-00-0-00		•	5	•			4				1						•	
F065313	1850P-R-RRR-0-1-03-5-M0-00-0-00		•	5			•	4				1						•	

**Note:** Please contact GEFTRAN for information on available codes.

