



CERTIFICATE OF COMPLIANCE

CERTIFICATE NUMBER: 050902 - E227487

ISSUE DATE: September 05, 2002 Page 1 of 2

Issued to: Datasensor S.p.A.
Via Lavino No. 265
I-40050 Monte S. Pietro Bologna Italy

Report Reference: E227487, June 26, 2002


This is to Certify that representative samples of: Industrial Control Equipment, Listed - Proximity Switches, Photoelectric Sensing Devices.
See the Addendum for Series

Have been investigated by Underwriters Laboratories Inc.® in accordance with the Standard(s) indicated on this Certificate.


Standard(s) for Safety: UL 508 - Industrial Control Equipment
CSA C22.2 No. 14-95 - Industrial Control Equipment


Additional Information: Electrical Ratings:
The devices "S60, S62, S65 and S90 Series" are rated 10-30 V dc, 100 mA maximum. They are intended to be supplied from a Class 2 transformer or power source.

Only those products bearing the UL Listing Mark for the US and Canada should be considered as being covered by UL's Listing and Follow-Up Service meeting the appropriate requirements for US and Canada.

The UL Listing Mark for the US and Canada generally includes: the UL in a circle symbol with "C" and "US" identifiers;  the word "LISTED"; a control number (may be alphanumeric) assigned by UL; and the product category name (product identifier) as indicated in the appropriate UL Directory.

LOOK FOR THE UL LISTING MARK ON THE PRODUCT

Engineer:

Giuseppe Redaelli - Conformity Assessment Services
UL International Italia S.r.l

Review Engineer:

Timothy W. Lueck - Conformity Assessment Services
UL International Italia S.r.l

Pursuant to the Corporate Services Agreement between UL International Italia Srl and Underwriters Laboratories Inc. ("UL"), UL hereby accepts and issues this Certificate of Compliance. For questions in Italy, you may call 079 2636600.



Underwriters Laboratories Inc.®

CERTIFICATE OF COMPLIANCE - ADDENDUM

CERTIFICATE NUMBER: 050902 - E227487

Page 2 of 2

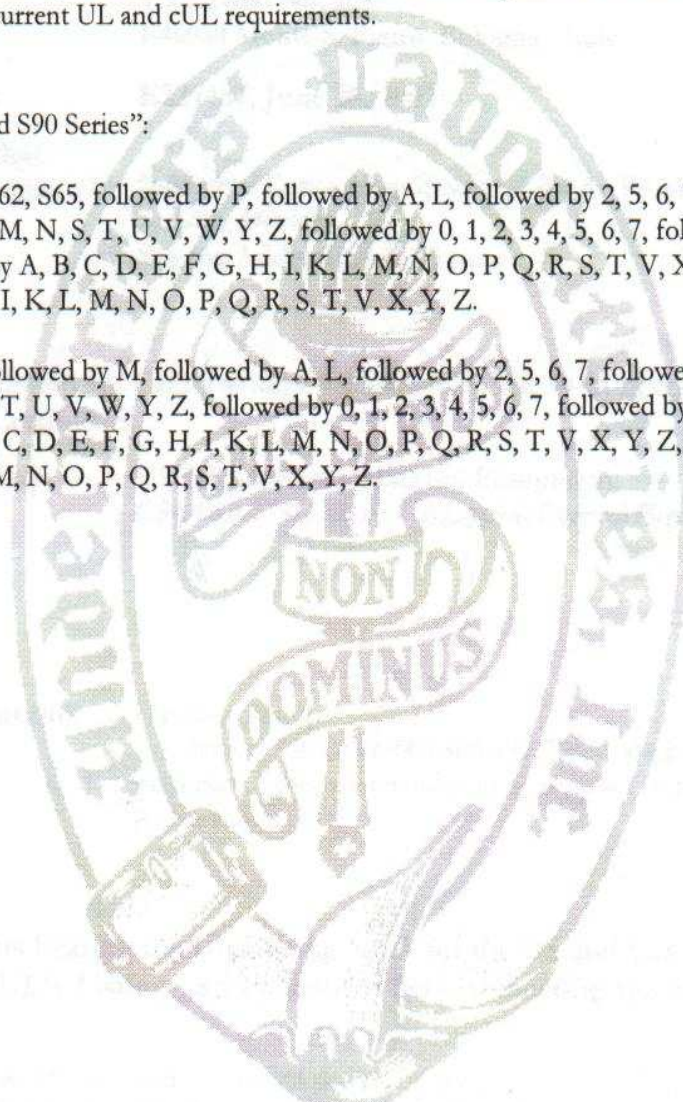
ISSUE DATE: September 05, 2002

This is to verify that representative samples of the product as specified on this certificate were tested according to the current UL and cUL requirements.

“S60, S62, S65 and S90 Series”:

Model No. S60, S62, S65, followed by P, followed by A, L, followed by 2, 5, 6, 7, followed by A, B, C, D, E, F, G, H, K, L, M, N, S, T, U, V, W, Y, Z, followed by 0, 1, 2, 3, 4, 5, 6, 7, followed by 0, 1, 2, 3, 4, 5, 6, 7, 8, 9, followed by A, B, C, D, E, F, G, H, I, K, L, M, N, O, P, Q, R, S, T, V, X, Y, Z, followed by A, B, C, D, E, F, G, H, I, K, L, M, N, O, P, Q, R, S, T, V, X, Y, Z.

Model No. S90 followed by M, followed by A, L, followed by 2, 5, 6, 7, followed by A, B, C, D, E, F, G, H, K, L, M, N, S, T, U, V, W, Y, Z, followed by 0, 1, 2, 3, 4, 5, 6, 7, followed by 0, 1, 2, 3, 4, 5, 6, 7, 8, 9, followed by A, B, C, D, E, F, G, H, I, K, L, M, N, O, P, Q, R, S, T, V, X, Y, Z, followed by A, B, C, D, E, F, G, H, I, K, L, M, N, O, P, Q, R, S, T, V, X, Y, Z.



Engineer: *Giuseppe Redaelli* / R
Giuseppe Redaelli - Conformity Assessment Services

Review Engineer: *Timothy W. Lueck* / R
Timothy W. Lueck - Conformity Assessment Services